

## PACKAGED TERMINAL AIR CONDITIONER (PTAC) CERTIFIED DRAWING

DWG. NO. **Submittal Template RSMK**  
REV. -

PROJECT		DATE		QTY	BY		REVISIONS
PURCHASER		P.O. #			DATE	BY	DESCRIPTION
ARCHITECT		SHIP DATE					
ENGINEER							
HVAC CONTR.							
GEN. CONTR.		CHASSIS					

DESIGNATION	MODEL NUMBER	QTY	ENCLOSURE (1)		SLEEVE (2)		LOUVER (3)		HTG COIL (4)		MOTORIZED VALVE		HEAT STAT		HTG COIL FRAME	
			STD	SPCL	STD	SPCL	STD	SPCL	STEAM	HOT WATER	YES	NO	YES	NO	YES	NO
A																
B																
C																
TOTAL																

### UNIT SPECIFICATIONS+

SERIES MODEL #	5RSMK09	5RSMK13	8RSMK13	8RSMK16	7RSMK09	7RSMK13
COOLING CAPACITY*	8,550	11,750	11,500	13,500	8,550	11,750
EER	9.1	8.4	8.5	8.05	9.1	8.4
HEATING CAPACITY (HOT WATER)**	15,500	15,500	15,500	15,500	15,500	15,500
HEATING CAPACITY (STEAM)***	18,700	18,700	18,700	18,700	18,700	18,700
ELECTRIC HEATING MAX. (KW)	1.5	1.5	4.3	4.3	3.5	3.5
VOLTAGE	115	115	208/230	208/230	277	277
AMPERAGE	8.2	12.2	6.5	8.1	3.4	5.0
WATTS	940	1,399	1,353	1,677	940	1,399
CFM ROOM AIR HIGH	370	370	430	430	370	370
CFM ROOM AIR LOW	350	350	370	370	350	350

### SPECIFICATION NOTES:

- \* = BTUH @ 80°F. DB/67°F. WB INDOORS; 95°F. DB OUTDOORS.
- \*\* = BTUH @ 200°F. E.W.T.; 65°F. E.A.T. & 2 G.P.M. FLOW RATE.
- \*\*\* = BTUH @ 2 PSIG STEAM & 65°F. E.A.T.
- FOR CAPACITIES AT CONDITIONS OTHER THAN THOSE SHOWN IN NOTES 1-3 ABOVE, USE GRAPHICS ON NEXT PAGE.

### GENERAL NOTES:


- N.Y.C. DEPARTMENT OF BUILDINGS ACCEPTED. MEA 250-93-E.-VOL. II
- SEE ACCOMPANYING DRAWINGS FOR UNIT CONFIGURATION.
- UNITS COME WITH COOLING CHASSIS ONLY. ENCLOSURE, SLEEVE LOUVERS, HEATING DECKS AND CONTROLS ARE BY OTHERS.

### CUSTOM NOTES:

- 

### PERFORMANCE DATA

#### COOLING CAPACITY CORRECTION FACTORS

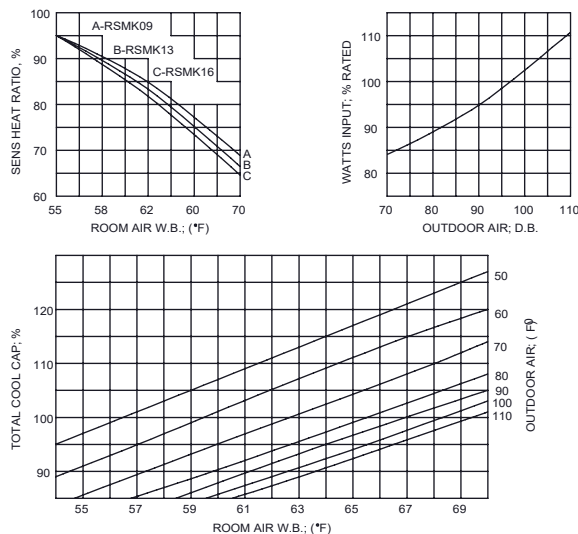

#### HEATING CAPACITY CORRECTION FACTORS

