


Packaged Terminal Air Conditioner for Replacement

RSK Series

Ice Air's RSK Series Replacement and Retrofit units are high energy efficiency PTACs. Designed from the ground up for ultra-high efficiency, they incorporate advanced LEEDs features in a durable and user-friendly package.

Features:

- Ultra-high efficiency – EERs to 9.5
- Advanced tangential indoor blower provides balanced air flow
- Whisper quiet sound levels
- Standard programmable digital touchpad controls
- 5/2 or 7 day programming
- Heavy duty, commercial-grade construction throughout
- G90 galvanized steel construction, powder-coated drain and base pans
- Furniture-grade, powder-coated cabinetry

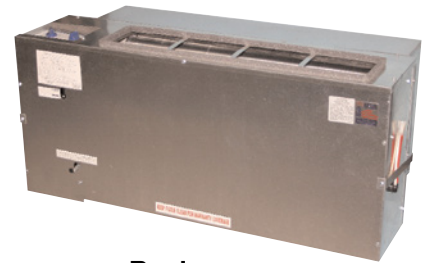

Replaces:

Ice-Cap – RSK
 Islandaire – RK
 Retroaire – RC/RH22

SERIES MODEL #	5RSK07	5RSK09	5RSK13	8RSK09	8RSK13	8RSK16	8RSK18	7RSK09	7RSK13
COOLING CAPACITY*	7,100	9,000	12,600	9,000	12,250	15,000	17,100	9,000	12,250
EER	9.5	9.0	8.25	9.0	8.3	7.8	7.7	9.0	8.3
HEATING CAPACITY (HOT WATER)**	16,500	16,500	16,500	16,500	16,500	19,400	19,400	16,500	16,500
HEATING CAPACITY (STEAM)***	18,700	18,700	18,700	18,700	18,700	20,200	20,200	18,700	18,700
ELECTRIC HEATING MAX. (KW)	1.5	1.5	1.5	4.3	4.3	4.3	4.3	3.5	3.5
VOLTAGE	115	115	115	208/230	208/230	208/230	208/230	277	277
AMPERAGE	6.5	8.7	13.3	4.8	7.1	9.2	10.7	3.6	5.3
WATTS	747	1000	1,527	1000	1,476	1,923	2,221	1,000	1,476
CFM ROOM AIR HIGH	350	350	400	350	450	450	450	350	450
CFM ROOM AIR LOW	260	260	350	260	350	370	370	260	350
CFM OUTSIDE AIR(4)	60	60	60	60	60	60	60	60	60
CFM X OUTSIDE AIR	110	110	110	110	110	110	110	110	110
WEIGHT NET/SHIP	113/129	117/133	117/133	117/133	117/133	132/148	141/157	117/133	117/133

SPECIFICATION NOTES:

1:* = BTUH @ 80°F. DB/67 °F. WB INDOORS; 95 °F. DB OUTDOORS.

2:** = BTUH @ 200 °F. E.W.T.; 65 °F. E.A.T. & 2 G.P.M. FLOW RATE.

3:*** = BTUH @ 2 PSIG STEAM & 65 °F. E.A.T.

IMPORTANT: Accessories are optional. Deviations from standard accessories may affect performance; louver requires 70% free area per original OEM specification; room enclosures must provide sufficient return air, free flowing supply air and must be properly sealed to prevent air recirculation; any non-standard components or accessories must be reviewed and approved by Ice Air or approved distributor.